

Tel: (011) 805-5002
Fax: (011) 805-5033

Postal Address:
PO Box 7861
Halfway House, 1685

The AAAMSA Performance Test Certificate



NOT TRANSFERABLE

Section A: Particulars of Applicant

Applicant:

Origin Aluminium
P O Box 20971
DURBAN NORTH
4016

Certificate
Number

D0722

Section B: Description of sample submitted for testing

AAAMSA Class Designation:

A2

Applicants' Drawing Reference:

ORG. 001

Product

Alsycos Greellan Slider

Overall Dimensions:

1200mm w x 1200mm h

Glass Type:

Glass Thickness:

4mm clear float

Glazing Gaskets:

4mm Channel Gasket

Weather Seals:

Woolpile


Hardware:

Nylon Slider Handle

Joint Sealant:

Silicone

Dimensional Sketch of Sample

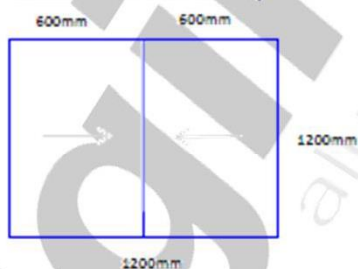

Comments by Testing Authority

Section C: Testing

Performance Test	Test Conditions	Measured Result	Allowed Result
1. Air Infiltration	75 Pa	0,23 l/sec/m ²	2.0 l/sec/m ²
2. Positive Pressure	1500 Pa	2.90 mm	6.86 mm
3. Negative Pressure	1500 Pa	2.64 mm	6.86 mm
4. Water Penetration	300 Pa	No Leaks	No Leaks
5. Structural Pressure	2250 Pa	No permanent deformation	No Permanent deformation
6. Operating Forces: To start movement		70N	120N
To sustain Movement		30N	80N

Section C: Testing

NOT TRANSFERABLE

Testing Authority:

(Stamp) Test Facility, Durban
R Saunderson PrEng
Reg. No. 703219

Validated by AAAMSA:

(Stamp) AAAMSA
PO Box 7861
Halfway House
1685

Date of issue: 26 June 2009

Date of Validation: 1 July 2009

Signed: Mr. R Saunderson

Signed:

Designation: Testing Officer

Designation: Executive Director

NOTE: THIS CERTIFICATE IS ISSUED SUBJECT TO THE CONDITIONS ON THE REVERSE SIDE